

# Hermetically Sealed PFA Temperature Sensor



These flexible PFA insulated sensors are ideally suited to applications which require resistance to attack from virtually all known chemicals, oils and fluids. A 3mm in diameter Stainless Steel protective sheath houses the PT100 sensor which is encapsulated within a 5mm diameter PFA tube along the entire length of the sensor, welded at the tip. A variety of lengths are available. The complete sensor is rated to 250°C. The sensors are Ex certified for use in explosive atmospheres/process.

## Specification

Material Body : PFA

Sensing Elements: PT100 Platinum Elements per IEC751 ( $\alpha = 0.00385 \Omega/\Omega/^{\circ}\text{C}$ )

Accuracy :  $\pm 0.03^{\circ}\text{C}$  to  $\pm 0.3^{\circ}\text{C}$  depending upon class selection

Operating Temperature: from  $-100$  to  $+250^{\circ}\text{C}$  selection dependant

Output: Pt100

Cable Type: PFA

Protection: IP65

Approvals: IEC 60079-0 : 2011, IEC 60079-11 : 2011, Sira 18ATEX2024X, IECEx

## Accessories



Enclosures



4/20mA Transmitters



Fittings




Controllers






L= SS316L 3mm Diameter x 100mm

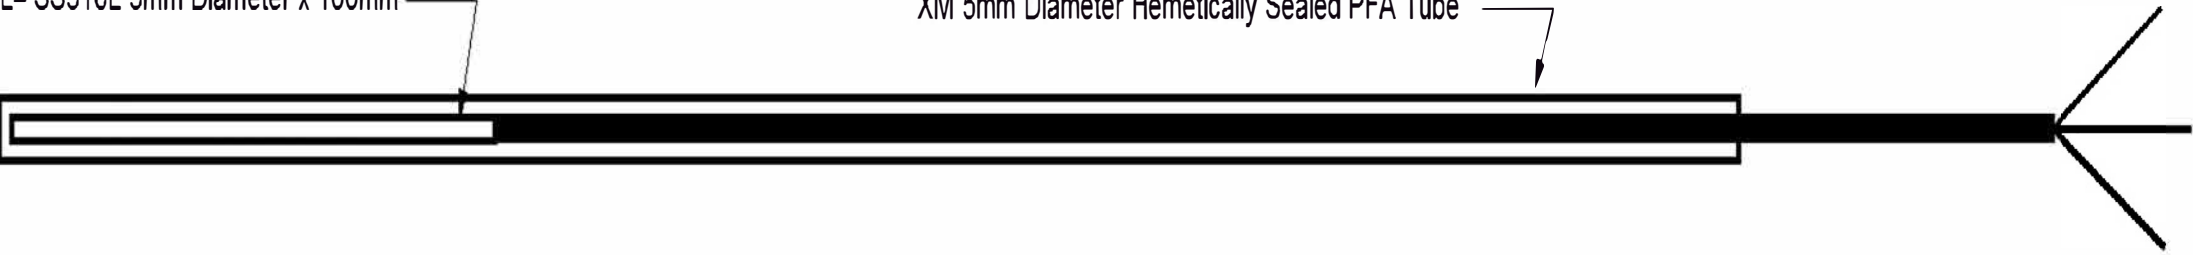XM 5mm Diameter Hemetically Sealed PFA Tube



II 1 GD  
Ex ia IIC T4 Ga  
Ex ia IIIC T135°C Da  
Ta = -40°C to +80°C



|              |  |  |                    |
|--------------|--|--|--------------------|
| <b>Model</b> | <b>Product Discription</b>   |  |                    |
| RTM13HSX     | RTD PT100 Hermetically Sealed  |  |                    |
| <b>Code</b>  | <b>Maximum Operating Temperature °C</b>  |  |                    |
| 250C         | 250°C  |  |                    |
| <b>Code</b>  | <b>Sensor Wiring</b>   |  |                    |
| 3W           | 3 Wire   |  |                    |
| 4W           | 4 Wire   |  |                    |
| <b>Code</b>  | <b>Sensor Configuration &amp; Class</b>  |  |                    |
| SA           | Single Element Class A ( $\pm 0.15^{\circ}\text{C}$ @ $0^{\circ}\text{C}$ )          |  |                    |
| S10          | Single Element Class 1/10th Din ( $\pm 0.03^{\circ}\text{C}$ @ $0^{\circ}\text{C}$ ) |  |                    |
| <b>Code</b>  | <b>Sensor Sheath Diameter</b>  |  |                    |
| 3            | 3mm Diameter Stainless Steel 1.4404 (316L)   |  |                    |
| <b>Code</b>  | <b>Sensor Sheath Length</b>  |  |                    |
| 100          | 100mm Sensor Sheath Length   |  |                    |
| <b>Code</b>  | <b>Cable Length in Meters</b>  |  |                    |
| XXX          | Specify in Meters  |  |                    |
| <b>Code</b>  | <b>Cable Type</b>  |  |                    |
| PFA          | PFA Cable & Tube   |  |                    |
| <b>Code</b>  | <b>Optional Termination Enclosure</b>  | <b>IP Rating</b>   | <b>Cable Entry</b> |
| SCH4         | ABS Plastic Enclosure  | IP65   | M20 Gland          |
| ABSL         | ABS Plastic Enclosure  | IP65   | M20 Gland          |
| SSBOX        | Special Polished Box 100 x 100 x 50  | IP65   | M20 Gland          |
| 7501         | Exd Aluminium Screw Cap Style  | IP68   | M20 Gland          |
| <b>Code</b>  | <b>Termination If Enclosure Selected</b>   |  | <b>Material</b>    |
| FL           | Flying Leads   |  |                    |
| TB           | Ceramic Din Style Termination Block  |  |                    |
| 5333D        |    | Ex Rated 2-wire programmable transmitter PT100 Input 4/20ma Output                 |                    |
| 5331D        |   | Ex Rated 2-wire programmable transmitter Universal Input 4/20ma Output             |                    |
| 5337D        |   | Ex Rated 2-wire programmable transmitter Universal Input 4/20ma Output HART 5 or 7 |                    |

# Sensor Configuration/Assembly

## Termination Heads

### Type: 5331D



#### 2-wire programmable transmitter 5331D

- RTD, TC, Ohm, or mV input
- Extremely high measurement accuracy
- 1.5 kVAC galvanic isolation
- Programmable sensor error value
- For DIN form B sensor head mounting

### Type: 5333D



#### 2-wire programmable transmitter 5333D

- RTD or Ohm input
- High measurement accuracy
- 3-wire connection
- Programmable sensor error value
- For DIN form B sensor head mounting

### Type: 5337D



#### 2-wire transmitter with HART protocol 5337D

- RTD, TC, Ohm, and bipolar mV input
- 2 analog inputs and 5 device variables with status available
- HART protocol revision selectable from HART 5 or HART 7
- Hardware assessed for use in SIL applications
- Mounting in hazardous gas and dust area

### Type: 7501



#### Field mounted HART temperature transmitter 7501


- RTD, TC, Ohm, and bipolar mV input and analog output
- High definition local operator interface (LOI) with 3 optical buttons
- Selectable red or white backlight
- Ex d explosion proof / flame proof
- HART 7 functionality with HART 5 compatibility

**Full Transmitter Specification Can Be Viewed Via Transmitter Datasheet**

## Wiring Configuration.


### Two Wire

When accuracy is not critical, a two-wire RTD is the least expensive; offering. Using lead wires to place any distance between a two wire RTD and a receiving device will further compromise its accuracy. The potential for poor accuracy from a two-wire RTD stems from its inability to compensate for lead length, resistance that changes the ohm value of the original signal. A two-wire RTD should be used only in applications where the receiving device connects directly to the sensor

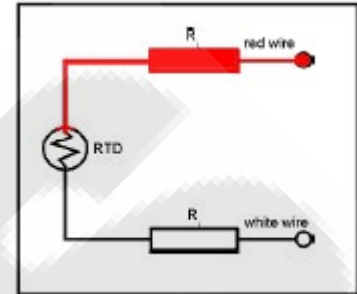


### Three Wire RTD

Three-wire RTD's compensate for resistance resulting from length differences by adding a third lead to the RTD. To accomplish this requires that the wires match exactly. Any difference in resistance between the lead wires will cause an imbalance, which will compromise the accuracy of the RTD. Lead length variance, work hardening or corrosion, and manufacturing irregularities are errors to avoid. Quality manufacturing is critical to insure balance of all three leads.

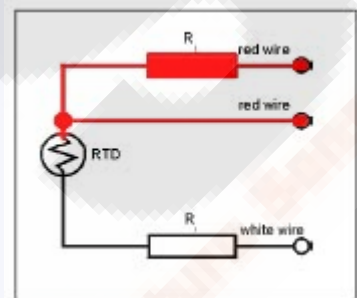

### Four Wire RTD

Errors caused by resistance imbalance between leads are cancelled out in a four-wire RTD circuit. Four-wire RTD's are used where superior accuracy is critical or if the sensor is installed far from the receiving device. In a four-wire RTD one pair of wires carries the current through the RTD the other pair senses the voltage across the RTD. 2- and three-wire RTD's require heavier lead wire because thicker wire, by creating less resistance to the measured signal, reduces measurement distortion. Therefore lighter gauge wire, less expensive, may be used in four-wire RTD applications. RTD's are limited to temperatures of 1200 ° F and because of the construction of the sensing element, RTD's do not do well in high-vibration and severe mechanical shock environments. When selecting a temperature sensor for an application you should consult your temperature sensor manufacturer for recommendations.

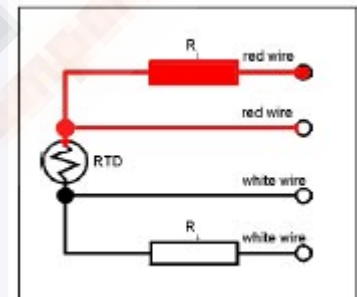

## Accuracy, Stability, and Repeatability.

| Tolerance/Accuracy is calculated as:   |  |
|--|--|
| Class B  | change in $t = \pm (0.3 + 0.005 t )$             |
| Class A  | change in $t = \pm (0.15 + 0.002 t )$            |
| 1/3 Class B  | change in $t = \pm 1/3 \times (0.3 + 0.005 t )$  |
| 1/5 Class B  | change in $t = \pm 1/5 \times (0.3 + 0.005 t )$  |
| 1/10 Class B   | change in $t = \pm 1/10 \times (0.3 + 0.005 t )$ |
| $ t $ = absolute temperature in °C. Where elements have a resistance of $n \times 100$ Ohms then the basic values and tolerances also have to be multiplied by $n$ |  |

These three terms are often confused, but it is important to understand the difference.

- Accuracy. IEC standard 751 sets two tolerance classes for the accuracy of RTDs: Class A and Class B:

Class A:  $\Delta t = \pm(0.15 + 0.002 \cdot |t|)$

Class B:  $\Delta t = \pm(0.30 + 0.005 \cdot |t|)$

where:

$|t|$  = absolute value of temperature in °C


Class A applies to temperatures from  $-200^{\circ}\text{C}$  to  $650^{\circ}\text{C}$ , and only for RTDs with three- or four-wire configurations. Class B covers the entire range from  $-200^{\circ}\text{C}$  to  $850^{\circ}\text{C}$ .

- **Stability.** This is the sensor's ability to maintain a consistent output when a constant input is applied. Physical or chemical changes can cause calibration drift. The material that the platinum is adhered to, whether wound on a mandrel or on a substrate, can expand and contract, straining the wire. Drift rates conservatively specified by manufacturers are typically  $0.05^{\circ}\text{C}/\text{yr}$ .
- **Repeatability.** Repeatability is the sensor's ability to give the same output or reading under repeated identical conditions.

Absolute accuracy is not necessary in most applications. The focus should be on the stability and repeatability of the sensor. If an RTD in a  $100.00^{\circ}\text{C}$  bath consistently reads  $100.06^{\circ}\text{C}$ , the electronics can easily compensate for this error. The stability of RTDs is exceptional, with most experiencing drift rates of  $0.05^{\circ}\text{C}$  over a five-year period.

### Response Time.

Response time varies according to the application. It is the sensor's ability to react to a change in temperature, and depends on the sensor's thermal mass and proximity to the material being tested. For instance, an RTD sensor in a thermowell will react more slowly than the same sensor immersed directly into a process. RTD specifications will list the sensor's time constant, which is the time it takes for an RTD to respond to a step change in temperature and come to 63% of its final equilibrium value. Response times are calculated in water flowing at 0.2 m/s and in air flowing at 1 m/s. This gives a useful comparison of RTD sensor configurations.

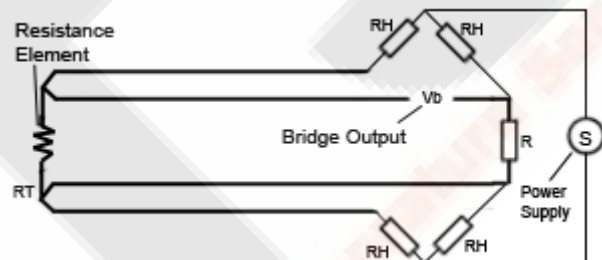

**Figure 3.** Lead wires have resistance that is a function of the material used, wire size, and lead length. This resistance can add to the measured RTD resistance, and improper wire compensation can result in significant errors. The common configurations of RTDs are two (A), three (B), or four wires (C).

## RTD accuracy – Class A, Class B, 1/3 DIN, 1/10 DIN

| ACTUAL  | RTD ACCURACY +/- °C PT100 Ω ALPHA 0.003850 to DIN 43760 IEC751 DIN EN 60 751 |         |                  |                   |
|---------|--|---------|------------------|-------------------|
|         | B GRADE  | A GRADE | BAND 3 (1/3 DIN) | BAND 5 (1/10 DIN) |
| -200 °C | 1.30 °C  | 0.55 °C | 0.39 °C          | 0.38 °C           |
| -150 °C | 1.05 °C  | 0.45 °C | 0.23 °C          | 0.21 °C           |
| -100 °C | 0.80 °C  | 0.35 °C | 0.15 °C          | 0.12 °C           |
| -90 °C  | 0.75 °C  | 0.33 °C | 0.14 °C          | 0.10 °C           |
| -80 °C  | 0.70 °C  | 0.31 °C | 0.13 °C          | 0.09 °C           |
| -70 °C  | 0.65 °C  | 0.29 °C | 0.12 °C          | 0.08 °C           |
| -60 °C  | 0.60 °C  | 0.27 °C | 0.11 °C          | 0.07 °C           |
| -50 °C  | 0.55 °C  | 0.25 °C | 0.10 °C          | 0.06 °C           |
| -40 °C  | 0.50 °C  | 0.23 °C | 0.10 °C          | 0.06 °C           |
| -30 °C  | 0.45 °C  | 0.21 °C | 0.09 °C          | 0.05 °C           |
| -20 °C  | 0.40 °C  | 0.19 °C | 0.09 °C          | 0.04 °C           |
| -10 °C  | 0.37 °C  | 0.17 °C | 0.08 °C          | 0.03 °C           |
| 0 °C    | 0.30 °C  | 0.15 °C | 0.08 °C          | 0.03 °C           |
| 10 °C   | 0.35 °C  | 0.17 °C | 0.09 °C          | 0.04 °C           |
| 20 °C   | 0.40 °C  | 0.19 °C | 0.10 °C          | 0.04 °C           |
| 30 °C   | 0.45 °C  | 0.21 °C | 0.11 °C          | 0.05 °C           |
| 40 °C   | 0.50 °C  | 0.23 °C | 0.12 °C          | 0.06 °C           |
| 50 °C   | 0.55 °C  | 0.25 °C | 0.13 °C          | 0.07 °C           |
| 60 °C   | 0.60 °C  | 0.27 °C | 0.14 °C          | 0.08 °C           |
| 70 °C   | 0.65 °C  | 0.29 °C | 0.16 °C          | 0.09 °C           |
| 80 °C   | 0.70 °C  | 0.31 °C | 0.17 °C          | 0.10 °C           |
| 90 °C   | 0.75 °C  | 0.33 °C | 0.18 °C          | 0.11 °C           |
| 100 °C  | 0.80 °C  | 0.35 °C | 0.19 °C          | 0.12 °C           |
| 110 °C  | 0.85 °C  | 0.37 °C | 0.20 °C          | 0.13 °C           |
| 120 °C  | 0.90 °C  | 0.39 °C | 0.21 °C          | 0.14 °C           |
| 130 °C  | 0.95 °C  | 0.41 °C | 0.22 °C          | 0.15 °C           |
| 140 °C  | 1.00 °C  | 0.43 °C | 0.24 °C          | 0.15 °C           |
| 150 °C  | 1.05 °C  | 0.45 °C | 0.25 °C          | 0.16 °C           |
| 160 °C  | 1.10 °C  | 0.47 °C | 0.26 °C          | 0.17 °C           |
| 170 °C  | 1.15 °C  | 0.49 °C | 0.27 °C          | 0.18 °C           |
| 180 °C  | 1.20 °C  | 0.51 °C | 0.29 °C          | 0.19 °C           |
| 190 °C  | 1.25 °C  | 0.53 °C | 0.30 °C          | 0.21 °C           |
| 200 °C  | 1.30 °C  | 0.55 °C | 0.31 °C          | 0.22 °C           |

Saved as 1393



# PT100 TEMPERATURE / RESISTANCE TABLE

| °C   | 0        | 1        | 2        | 3        | 4        | 5        | 6        | 7        | 8        | 9        | °C   |
|------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|------|
| -200 | 18.4932  |          |          |          |          |          |          |          |          |          | -200 |
| -190 | 22.8031  | 22.3737  | 21.9439  | 21.5139  | 21.0834  | 20.6526  | 20.2215  | 19.7899  | 19.3580  | 18.9258  | -190 |
| -180 | 27.0779  | 26.6520  | 26.2257  | 25.7990  | 25.3720  | 24.9447  | 24.5171  | 24.0891  | 23.6608  | 23.2321  | -180 |
| -170 | 31.3200  | 30.8972  | 30.4741  | 30.0507  | 29.6270  | 29.2029  | 28.7786  | 28.3539  | 27.9289  | 27.5036  | -170 |
| -160 | 35.5313  | 35.1115  | 34.6914  | 34.2710  | 33.8503  | 33.4294  | 33.0081  | 32.5865  | 32.1646  | 31.7425  | -160 |
| -150 | 39.7137  | 39.2967  | 38.8794  | 38.4619  | 38.0440  | 37.6260  | 37.2076  | 36.7889  | 36.3700  | 35.9508  | -150 |
| -140 | 43.8691  | 43.4547  | 43.0401  | 42.6252  | 42.2101  | 41.7946  | 41.3790  | 40.9631  | 40.5469  | 40.1304  | -140 |
| -130 | 47.9993  | 47.5873  | 47.1752  | 46.7628  | 46.3501  | 45.9372  | 45.5241  | 45.1107  | 44.6971  | 44.2832  | -130 |
| -120 | 52.1058  | 51.6962  | 51.2863  | 50.8762  | 50.4659  | 50.0554  | 49.6446  | 49.2336  | 48.8224  | 48.4109  | -120 |
| -110 | 56.1903  | 55.7828  | 55.3751  | 54.9672  | 54.5591  | 54.1507  | 53.7422  | 53.3334  | 52.9244  | 52.5152  | -110 |
| -100 | 60.2541  | 59.8486  | 59.4429  | 59.0371  | 58.6310  | 58.2247  | 57.8182  | 57.4115  | 57.0047  | 56.5976  | -100 |
| -90  | 64.2987  | 63.8950  | 63.4912  | 63.0873  | 62.6831  | 62.2787  | 61.8742  | 61.4695  | 61.0645  | 60.6594  | -90  |
| -80  | 68.3251  | 67.9233  | 67.5212  | 67.1190  | 66.7166  | 66.3141  | 65.9114  | 65.5084  | 65.1054  | 64.7021  | -80  |
| -70  | 72.3346  | 71.9344  | 71.5340  | 71.1335  | 70.7328  | 70.3319  | 69.9309  | 69.5297  | 69.1284  | 68.7268  | -70  |
| -60  | 76.3282  | 75.9296  | 75.5307  | 75.1318  | 74.7326  | 74.3334  | 73.9339  | 73.5343  | 73.1346  | 72.7347  | -60  |
| -50  | 80.3068  | 79.9096  | 79.5123  | 79.1148  | 78.7171  | 78.3194  | 77.9214  | 77.5234  | 77.1251  | 76.7268  | -50  |
| -40  | 84.2713  | 83.8754  | 83.4795  | 83.0834  | 82.6871  | 82.2908  | 81.8943  | 81.4976  | 81.1008  | 80.7039  | -40  |
| -30  | 88.2222  | 87.8277  | 87.4331  | 87.0383  | 86.6434  | 86.2484  | 85.8532  | 85.4579  | 85.0625  | 84.6669  | -30  |
| -20  | 92.1603  | 91.7671  | 91.3737  | 90.9802  | 90.5866  | 90.1929  | 89.7990  | 89.4050  | 89.0109  | 88.6166  | -20  |
| -10  | 96.0861  | 95.6941  | 95.3019  | 94.9097  | 94.5173  | 94.1247  | 93.7321  | 93.3394  | 92.9465  | 92.5535  | -10  |
| 0    | 100.0000 | 99.6091  | 99.2182  | 98.8271  | 98.4359  | 98.0445  | 97.6531  | 97.2615  | 96.8698  | 96.4780  | 0    |
| 0    | 100.0000 | 100.3907 | 100.7814 | 101.1719 | 101.5623 | 101.9526 | 102.3427 | 102.7328 | 103.1227 | 103.5125 | 0    |
| 10   | 103.9022 | 104.2918 | 104.6813 | 105.0706 | 105.4599 | 105.8490 | 106.2380 | 106.6269 | 107.0156 | 107.4043 | 10   |
| 20   | 107.7928 | 108.1813 | 108.5696 | 108.9578 | 109.3458 | 109.7338 | 110.1216 | 110.5094 | 110.8970 | 111.2845 | 20   |
| 30   | 111.6718 | 112.0591 | 112.4463 | 112.8333 | 113.2202 | 113.6070 | 113.9937 | 114.3802 | 114.7667 | 115.1530 | 30   |
| 40   | 115.5392 | 115.9254 | 116.3113 | 116.6972 | 117.0830 | 117.4686 | 117.8541 | 118.2395 | 118.6248 | 119.0100 | 40   |
| 50   | 119.3951 | 119.7800 | 120.1648 | 120.5495 | 120.9341 | 121.3186 | 121.7030 | 122.0872 | 122.4713 | 122.8554 | 50   |
| 60   | 123.2392 | 123.6230 | 124.0067 | 124.3902 | 124.7737 | 125.1570 | 125.5402 | 125.9233 | 126.3063 | 126.6891 | 60   |
| 70   | 127.0718 | 127.4545 | 127.8370 | 128.2194 | 128.6016 | 128.9838 | 129.3658 | 129.7478 | 130.1296 | 130.5113 | 70   |
| 80   | 130.8928 | 131.2743 | 131.6556 | 132.0369 | 132.4180 | 132.7990 | 133.1799 | 133.5606 | 133.9413 | 134.3218 | 80   |
| 90   | 134.7022 | 135.0825 | 135.4627 | 135.8428 | 136.2227 | 136.6026 | 136.9823 | 137.3619 | 137.7414 | 138.1207 | 90   |
| 100  | 138.5000 | 138.8791 | 139.2582 | 139.6371 | 140.0159 | 140.3945 | 140.7731 | 141.1515 | 141.5299 | 141.9081 | 100  |
| 110  | 142.2862 | 142.6642 | 143.0420 | 143.4198 | 143.7974 | 144.1749 | 144.5523 | 144.9296 | 145.3068 | 145.6838 | 110  |
| 120  | 146.0608 | 146.4376 | 146.8143 | 147.1909 | 147.5673 | 147.9437 | 148.3199 | 148.6960 | 149.0721 | 149.4479 | 120  |
| 130  | 149.8237 | 150.1994 | 150.5749 | 150.9504 | 151.3257 | 151.7009 | 152.0759 | 152.4509 | 152.8257 | 153.2005 | 130  |
| 140  | 153.5751 | 153.9496 | 154.3240 | 154.6982 | 155.0724 | 155.4464 | 155.8203 | 156.1941 | 156.5678 | 156.9414 | 140  |
| 150  | 157.3149 | 157.6882 | 158.0614 | 158.4345 | 158.8075 | 159.1804 | 159.5531 | 159.9258 | 160.2983 | 160.6707 | 150  |
| 160  | 161.0430 | 161.4152 | 161.7872 | 162.1592 | 162.5310 | 162.9027 | 163.2743 | 163.6458 | 164.0172 | 164.3884 | 160  |
| 170  | 164.7596 | 165.1306 | 165.5015 | 165.8723 | 166.2429 | 166.6135 | 166.9839 | 167.3542 | 167.7245 | 168.0945 | 170  |
| 180  | 168.4645 | 168.8344 | 169.2041 | 169.5737 | 169.9432 | 170.3126 | 170.6819 | 171.0511 | 171.4201 | 171.7890 | 180  |
| 190  | 172.1579 | 172.5266 | 172.8951 | 173.2636 | 173.6319 | 174.0002 | 174.3683 | 174.7363 | 175.1042 | 175.4719 | 190  |
| 200  | 175.8396 | 176.2071 | 176.5746 | 176.9419 | 177.3090 | 177.6761 | 178.0431 | 178.4099 | 178.7766 | 179.1432 | 200  |
| 210  | 179.5097 | 179.8761 | 180.2424 | 180.6085 | 180.9745 | 181.3405 | 181.7063 | 182.0719 | 182.4375 | 182.8029 | 210  |
| 220  | 183.1683 | 183.5335 | 183.8986 | 184.2636 | 184.6284 | 184.9932 | 185.3578 | 185.7223 | 186.0867 | 186.4510 | 220  |
| 230  | 186.8152 | 187.1793 | 187.5432 | 187.9070 | 188.2707 | 188.6343 | 188.9978 | 189.3611 | 189.7244 | 190.0875 | 230  |
| 240  | 190.4505 | 190.8134 | 191.1762 | 191.5389 | 191.9014 | 192.2638 | 192.6262 | 192.9884 | 193.3504 | 193.7124 | 240  |
| 250  | 194.0743 | 194.4360 | 194.7976 | 195.1591 | 195.5205 | 195.8818 | 196.2429 | 196.6040 | 196.9649 | 197.3257 | 250  |
| 260  | 197.6864 | 198.0469 | 198.4074 | 198.7677 | 199.1280 | 199.4881 | 199.8481 | 200.2079 | 200.5677 | 200.9274 | 260  |
| 270  | 201.2869 | 201.6463 | 202.0056 | 202.3648 | 202.7238 | 203.0828 | 203.4416 | 203.8003 | 204.1589 | 204.5174 | 270  |
| 280  | 204.8758 | 205.2340 | 205.5922 | 205.9502 | 206.3081 | 206.6659 | 207.0236 | 207.3811 | 207.7386 | 208.0959 | 280  |
| 290  | 208.4531 | 208.8102 | 209.1672 | 209.5240 | 209.8808 | 210.2374 | 210.5939 | 210.9503 | 211.3066 | 211.6628 | 290  |
| 300  | 212.0188 | 212.3747 | 212.7305 | 213.0862 | 213.4418 | 213.7973 | 214.1527 | 214.5079 | 214.8630 | 215.2180 | 300  |
| 310  | 215.5729 | 215.9277 | 216.2823 | 216.6369 | 216.9913 | 217.3456 | 217.6998 | 218.0539 | 218.4078 | 218.7617 | 310  |
| 320  | 219.1154 | 219.4690 | 219.8225 | 220.1759 | 220.5291 | 220.8823 | 221.2353 | 221.5882 | 221.9410 | 222.2937 | 320  |
| 330  | 222.6463 | 222.9987 | 223.3511 | 223.7033 | 224.0554 | 224.4074 | 224.7592 | 225.1110 | 225.4626 | 225.8142 | 330  |
| 340  | 226.1656 | 226.5169 | 226.8680 | 227.2191 | 227.5700 | 227.9209 | 228.2716 | 228.6222 | 228.9726 | 229.3230 | 340  |
| 350  | 229.6733 | 230.0234 | 230.3734 | 230.7233 | 231.0731 | 231.4227 | 231.7723 | 232.1217 | 232.4710 | 232.8202 | 350  |



